


## HANFORD SITE STAFFING TANK WASTE REMEDIATION SYSTEM

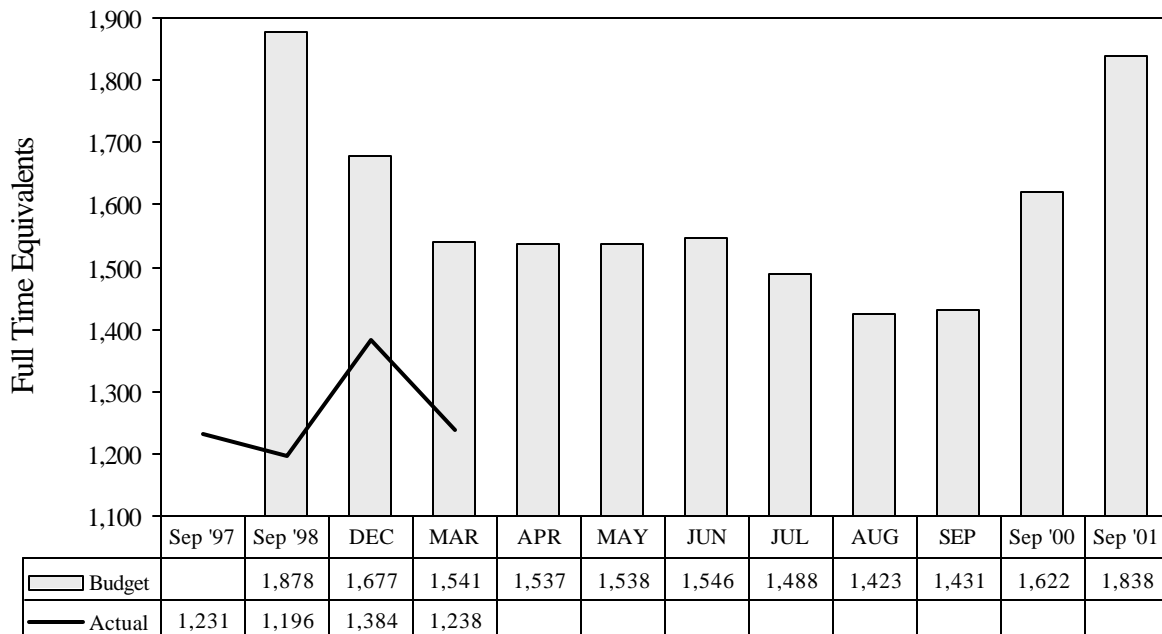

The TWRS March FYTD positive FTE variance is primarily due to the use of on-site sub-contract personnel in place of the planned PHMC staff. Sub-contractor support is not reported as FTEs.